

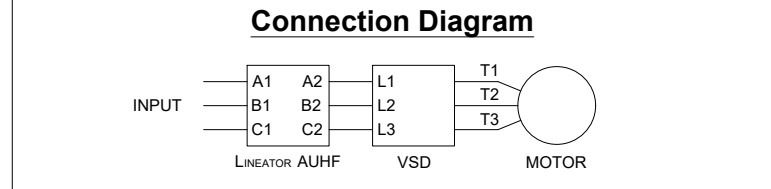
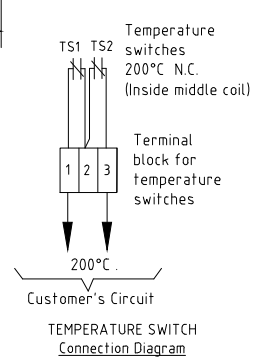
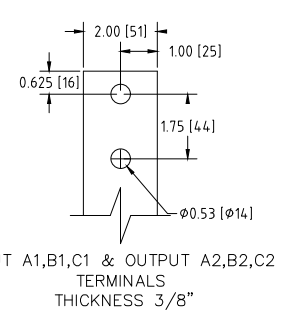
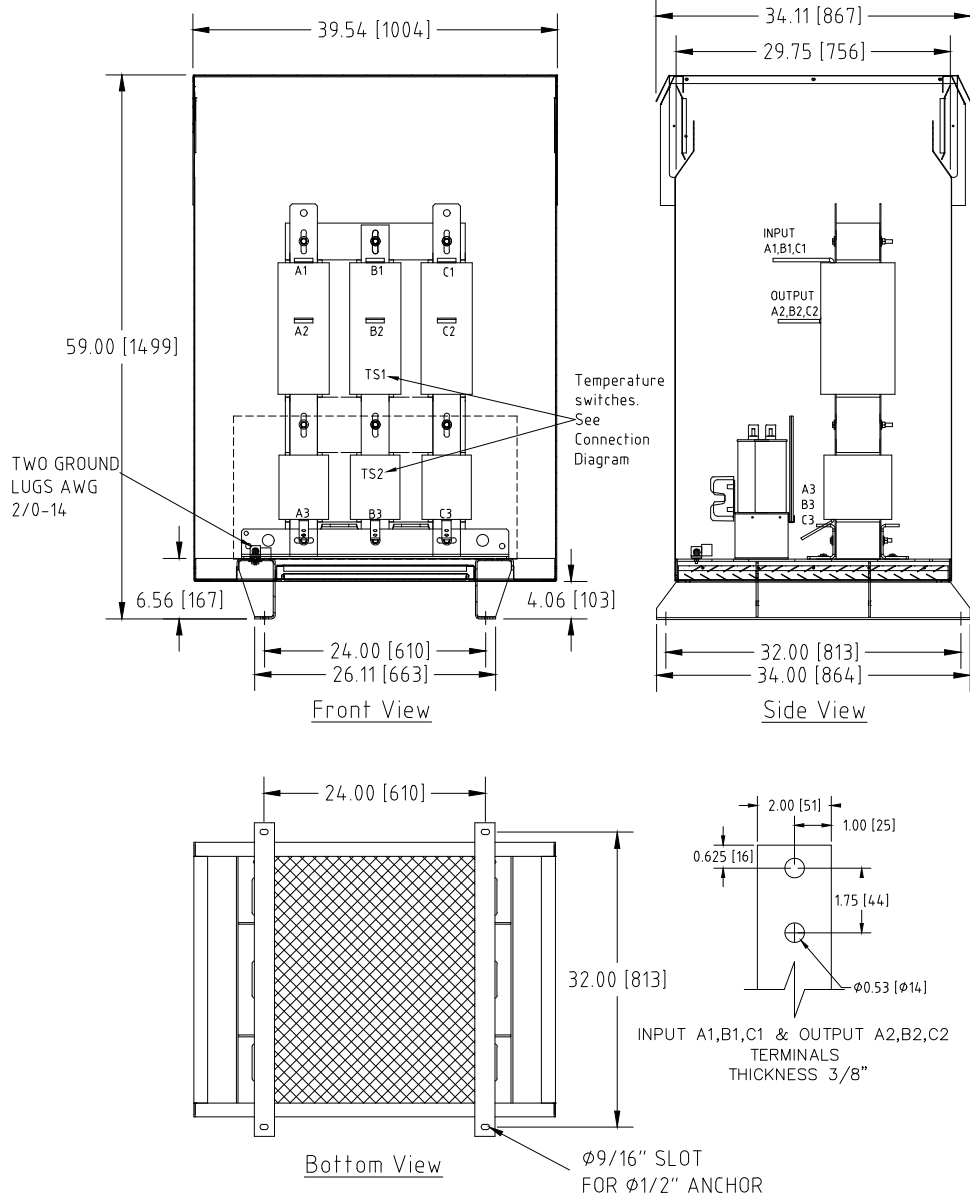


Rev. No.	Revision Note	Date	By	Checked
A17	ADDED MIDDLE YOKE BRACKET	26-JAN-2021	CG	AH
A18	REVISED REACTOR BRACKETS	03-FEB-2021	CG	BDK

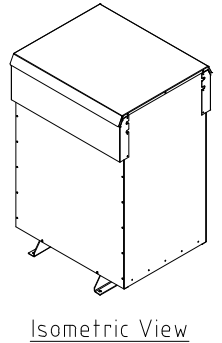

UNIT SPECIFICATIONS			INPUT	OUTPUT	APPROX. WT,
HP (kW)	PHASE	VOLTS	AMPS	kW	lb (kg)
500 (400)	3	480	595	443	1250 (568)

NOTES:
 1. Customer is responsible for installation to meet all national and local electrical codes and other applicable electrical safety authorities.
 2. Type 3R Enclosure requires only front access but minimum 6" clearance should be provided at rear for proper ventilation.

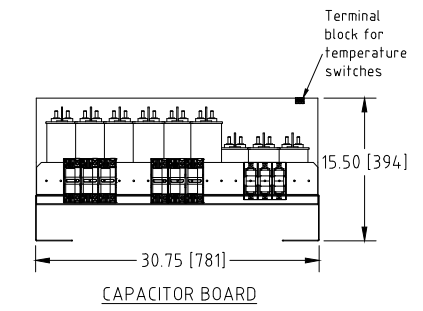

MIRUS International Inc. 31 Sun Pac Boulevard, Brampton, ON, Canada L6S 5P6
 Tel: (905) 494-1120 Fax: (905) 494-1140 Toll Free: 1-888-TO MIRUS

Unless otherwise specified, dimensions are in inches and [mm].	Drawn by BW	Date 18-OCT-07	Checked by YM	Approved by - date YM - 18-OCT-07	Scale NTS
The information contained herein is the sole property of MIRUS International Inc. Any form of reproduction, distribution and/or disclosure of this information, all or in part, is strictly prohibited without the express written consent of MIRUS International Inc.		Title 500 HP, 480V, 60Hz Enhanced Enclosed Style Lineator AUHF			
Filename AUHF-500-480-60-D-E1E-A18			Revision A18	Sheet 1/1	