




Rev. No.	Revision Note	Date	By	Checked
A13	REVISED REACTOR DESIGN	23-JUL-2020	CG	BDK
A14	REVISED BRACKET DESIGN	05-MAR-2021	CG	BDK

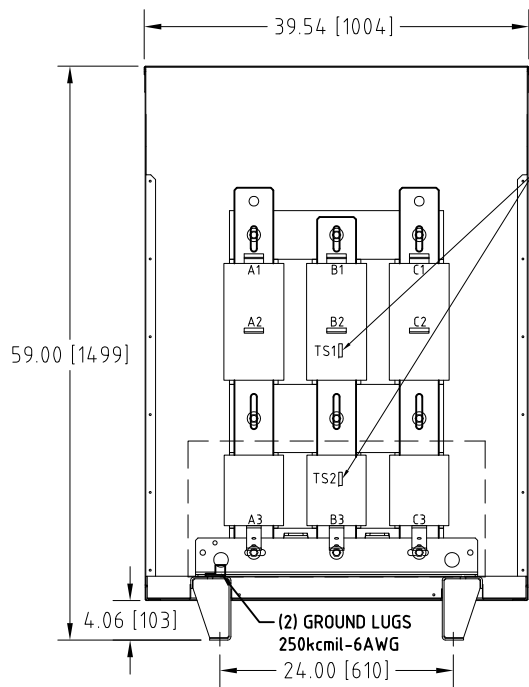


Front View
(Behind Capacitors)

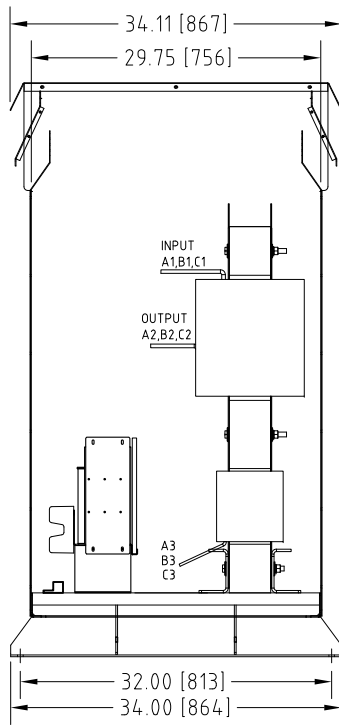


Side View

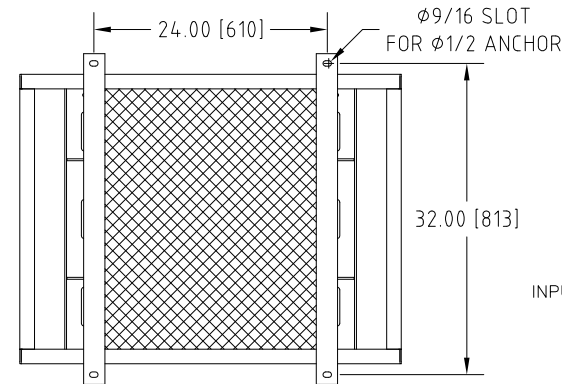


Bottom View




INPUT A1,B1,C1 & OUTPUT A2,B2,C2
TERMINALS
THICKNESS 3/8"

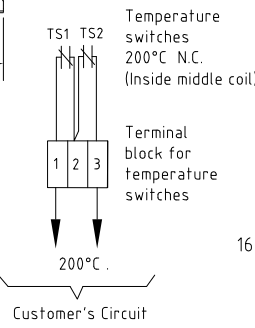

TEMPERATURE SWITCH
Connection Diagram

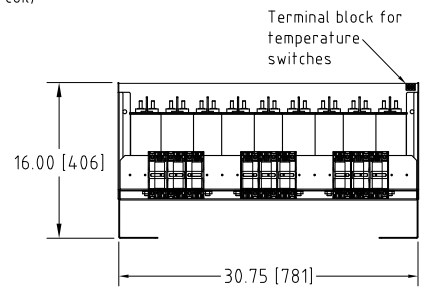


CAPACITOR BOARD

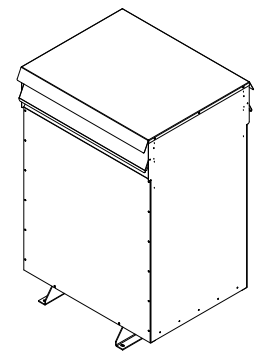

Isometric View

Connection Diagram

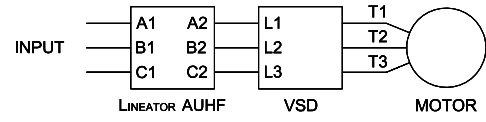

UNIT SPECIFICATIONS				INPUT	OUTPUT	APPROX. WT
HP [kW]	PHASE	VOLTS	Hz	AMPS	kW	lb [kg]
600 [450]	3	480	60	670	499	1200 [545]

NOTES:
 1. Customer is responsible for installation to meet all national and local electrical codes and other applicable electrical safety authorities.
 2. Type 3R Enclosure requires only front access but minimum 6" clearance should be provided at rear for proper ventilation..

MIRUS International Inc. 31 Sun Pac Boulevard, Brampton, ON, Canada L6S 5P6
 Tel: (905) 494-1120 Fax: (905) 494-1140 Toll Free: 1-888-TO MIRUS

Unless otherwise specified, dimensions are in inches and [mm].	Drawn By BW	Date Created 18-OCT-07	Checked by YM	Approved by - date YM-18-OCT-07	Scale NTS
The information contained herein is the sole property of MIRUS International Inc. Any form of reproduction, distribution and/or disclosure of this information, all or in part, is strictly prohibited without the express written consent of MIRUS International Inc.			Title 600 HP, 480 V, 60 Hz LINEATOR™ AUHF (Type-3R)		
Filename AUHF-600-480-60-D-E1-A14			Revision A14		Sheet 1/1